

# CA88

Date: August 23, 1996

Ref: Ca088-0

Revision: 00

Author:

<b>Cable code</b>	CA88
<b>Description</b>	UniOP PLC Port to Toshiba Prog Port - Current Loop
<b>Type of Communication</b>	Current Loop
<b>Panel Connector</b>	D-sub type 15S
<b>PLC Connector</b>	Fujitsu FCN-361J008
<b>Notes</b>	<i>To be used only with the NEW type of Current Loop interface (-0042). Compatible with M20, M40, EX-100 and EX-250.</i>

table 1. Cable description

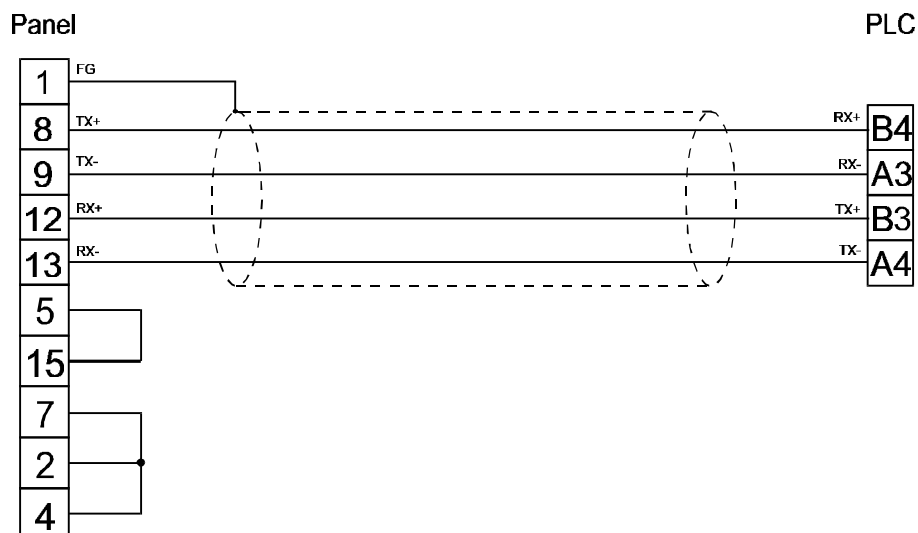


figure 1. Cable diagram