

CA165

Date: October 16, 1998
 Ref: Ca165-0.doc
 Revision: 00
 Author: CU

Cable code	CA165
Description	UniOP Aux port to SDS
Type of Communication	CAN (Controller Area Network) technology
Panel Connector	D-sub type 9P
Network Connector	
Notes	<p>Compatible only with panels of type -0045 using TCM03.</p> <p>To connect one or more panels to the SDS network refer to the available SDS documentation on Transmission Media Requirements.</p> <p>SDS requires a terminating resistor to be installed at each end of the network trunk. Usage of the Honeywell accessories is recommended (SDS-TERM and SDS-TERM-F).</p> <p>External network power supply (+24 Vcc) is necessary. Refer to SDS documentation for more details.</p> <p>Use specified cable (example Honeywell SDS-BLK-xxx).</p>

Table 1. Cable description

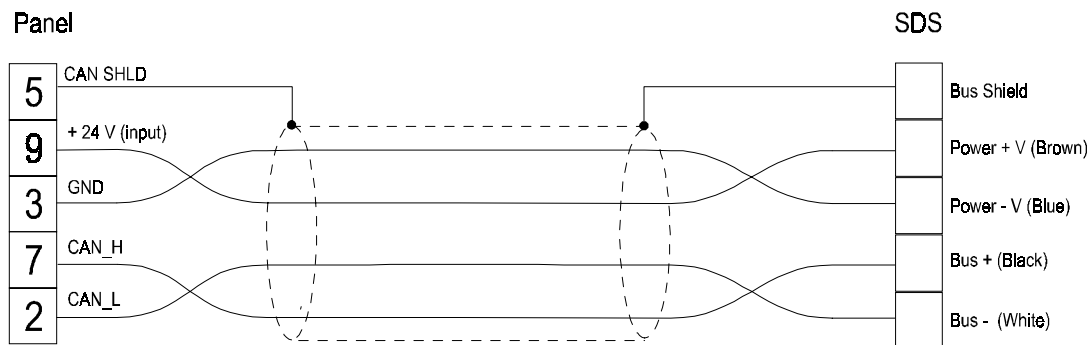


Figure 1. Cable diagram